


PLAN

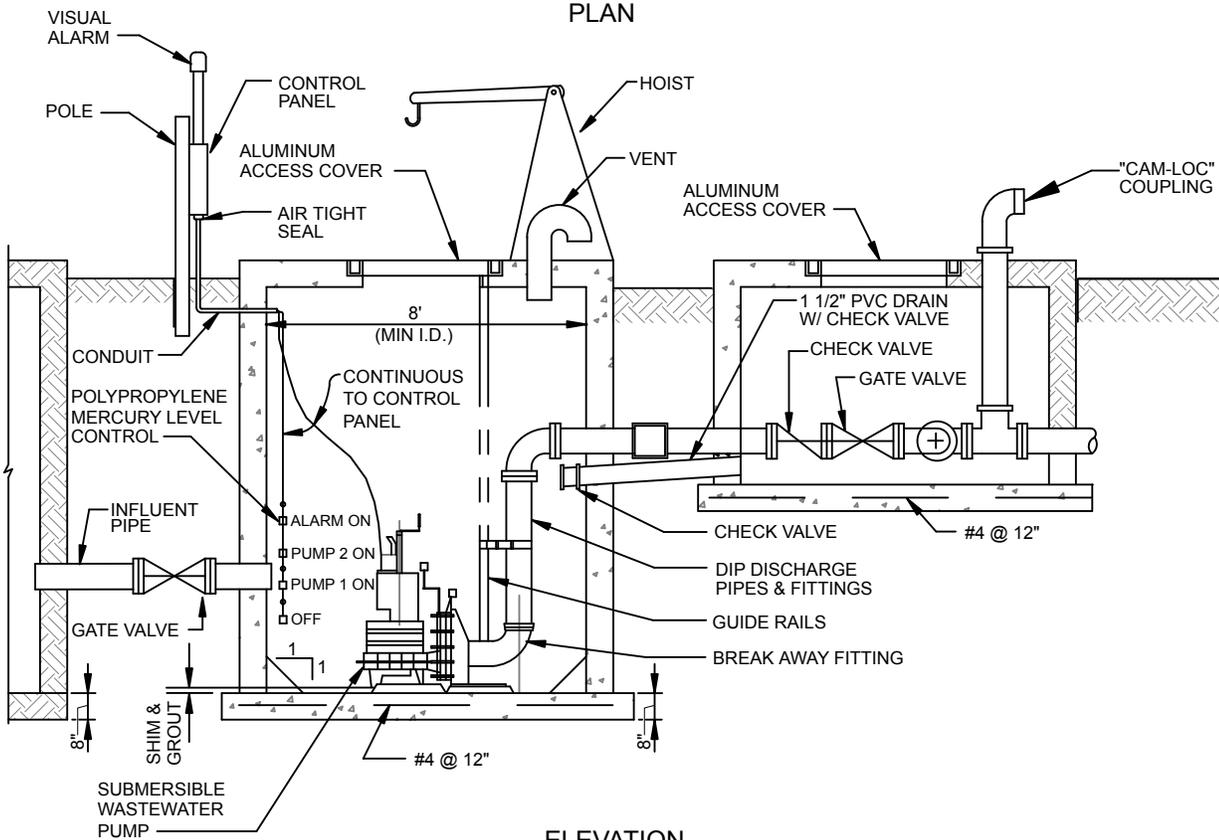

ELEVATION

NOTES:

1. PROVIDE A LADDER AT TOP OF DRYWELL FOR ACCESS TO THE VALVES.(FOR DEPTH OF 4 FEET OR GREATER)
2. A REMOTE SENSING/REPORTING SYSTEM COMPATIBLE WITH SCADA NETWORK.
3. PROVIDE STAINLESS STEEL CHAINS, PUMPRAILS AND BRACKETS.
4. PROVIDE A TWO-TON HOIST ASSEMBLY FOR PUMP REMOVAL.
5. INSTALL AN 8-FOOT CHAIN LINK FENCE WITH SECURITY WIRES AND A TEN-FOOT-WIDE, TWO LEAF GATE.

REVISION	BY	DATE	LIFT STATION STANDARD DETAILS	
			DATE:	STANDARD NO.
			05/05	SAN-11