


SECTION

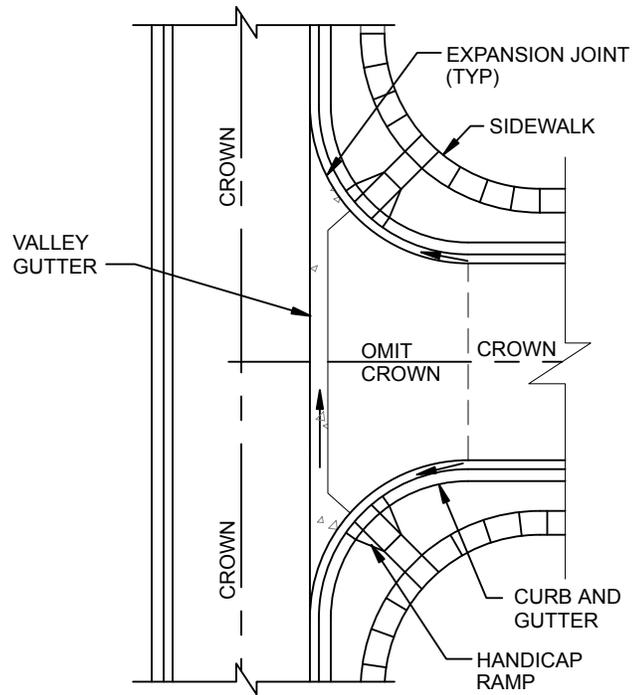

PLAN

VALLEY GUTTER

NOTES:

1. CONCRETE SHALL BE 4,000 PSI (ODOT CLASS AA)
2. EXPANSION JOINTS ARE REQUIRED AT INTERSECTION WITH CURB AND GUTTER.

:STANDARD DETAILS\STREET\STRT-07A

REVISION	BY	DATE	VALLEY GUTTER	
			STANDARD DETAILS	
			CITY OF OWASSO, OKLAHOMA	
			PUBLIC WORKS DEPARTMENT	
			ENGINEERING DIVISION	
			DATE: 05/05	STANDARD NO. STRT-07A